


MED-85 DIN

Installation dimensions

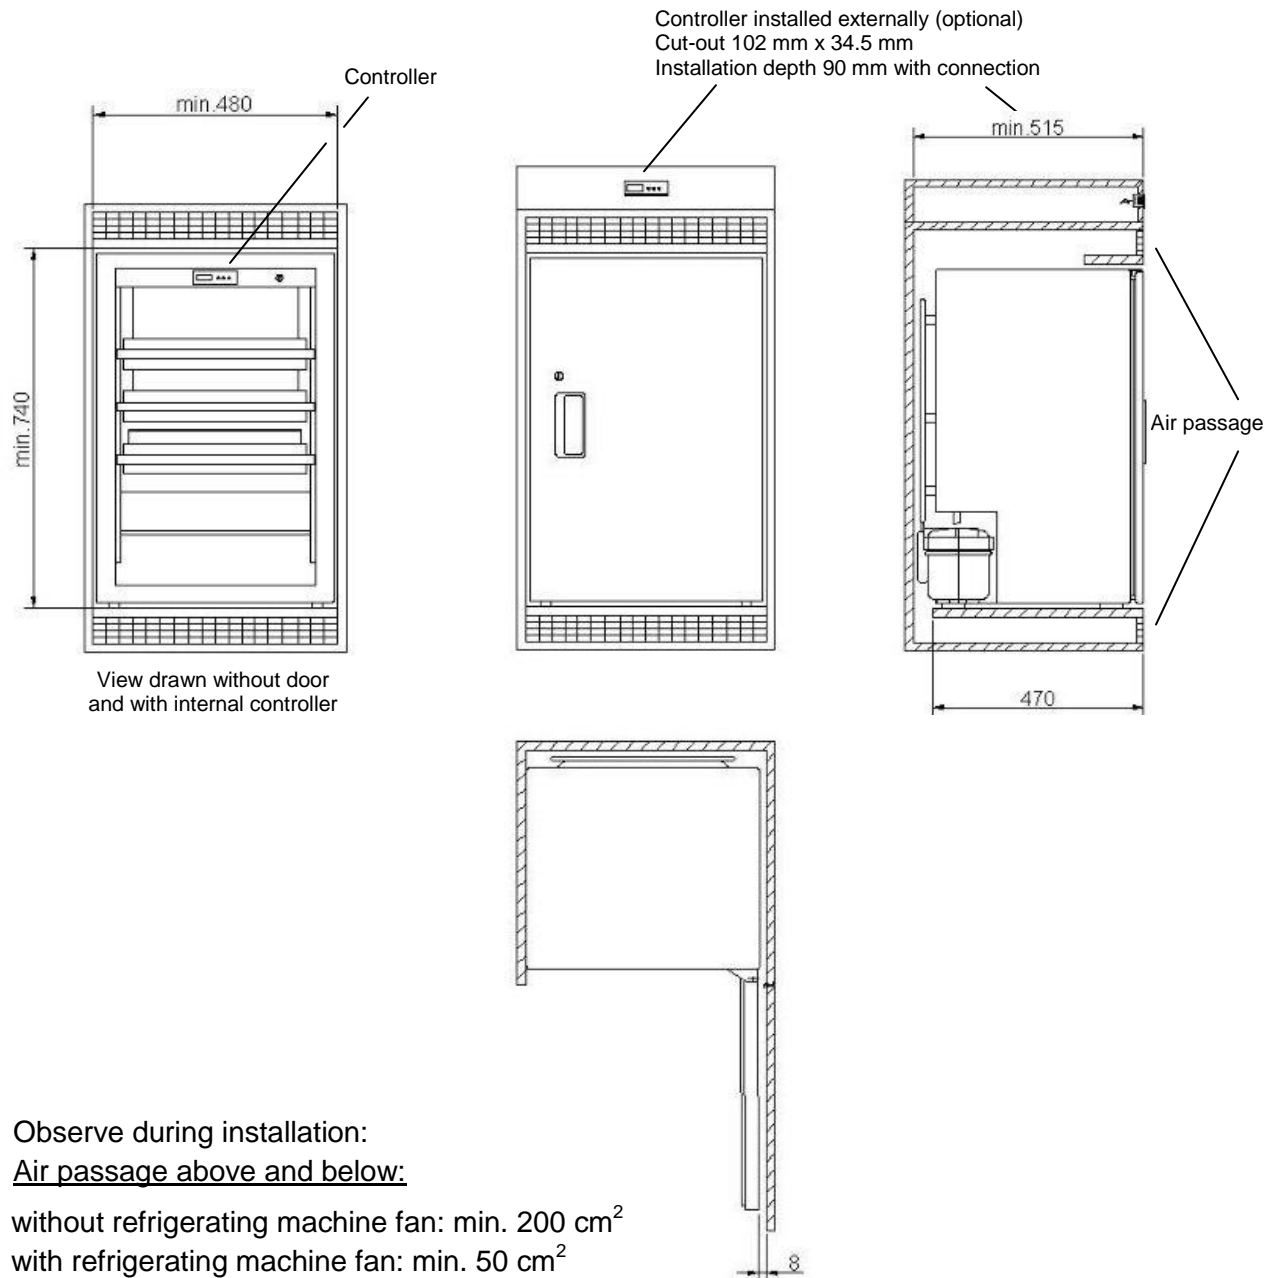

Observe during installation:

Air passage above and below:

without refrigerating machine fan: min. 200 cm²

with refrigerating machine fan: min. 50 cm²